
## **Planned Maintenance Schemes & Recent Reactive Repairs Activity Totteridge Ward - July 2016**

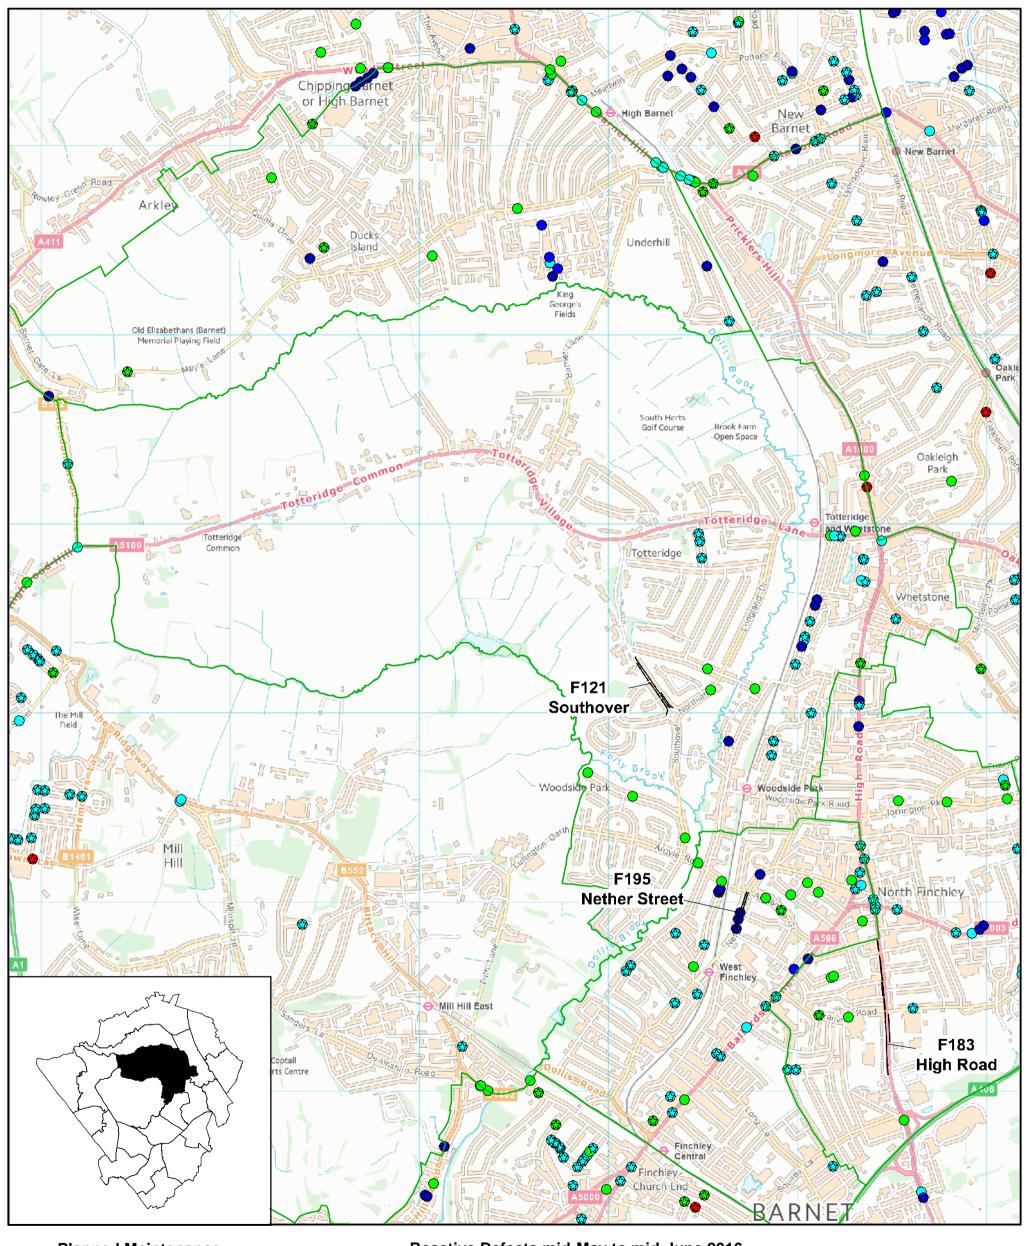

## **Planned Maintenance**

Active Schemes in July

Ward Boundaries

## Reactive Defects mid-May to mid-June 2016 **Carrriageway Defects Footway Defects**

- Emergency (within 2 hours)
- Cat 1 (within 48 hours)
- Cat 2 (within 7 days)
- Cat 3 (within 28 days)
- all others

- Emergency (within 2 hours)
- Cat 1 (within 48 hours)
- Cat 2 (within 7 days) Cat 3 (within 28 days)
- all others